


Phase Sequence Tester

Model 480400

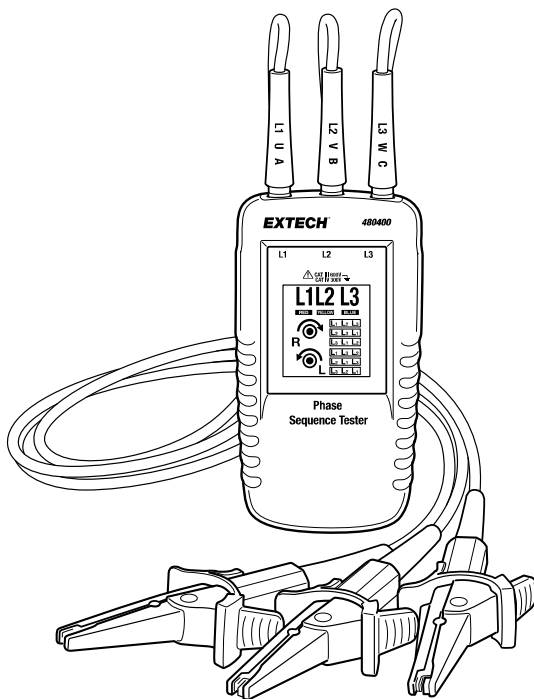

Introduction

Congratulations on your purchase of the Extech Model 408400 Phase Sequence Tester. This handheld instrument detects the phase sequence of three-phase systems. Color-coded test leads are provided for connecting to the three mains phases of the system under test. This meter is shipped fully tested and calibrated and, with proper use, will provide years of reliable service.

Safety

International Safety Symbols



Caution ! Refer to the explanation in this Manual



Caution ! Risk of electric shock



Earth (Ground)



Double Insulation or Reinforced insulation



AC, Alternating Current or Voltage



DC, Direct Current or Voltage

Safety Procedures


To avoid possible electric shock or fire, observe the following:

- Read the following information carefully before using or servicing the instrument.
- Adhere to local and national safety codes.
- Individual protective equipment must be used to prevent shock and injury.
- Use of instrument in a manner not specified by the manufacturer may impair safety features/protection provided by the equipment.
- Avoid working alone.
- Inspect the test leads for damaged insulation or exposed metal. Check test lead continuity. Damaged leads must be replaced. Do not use the phase Rotation indicator if it appears damaged.
- Use care when working above 30V ac rms, 42V ac peak and 60V dc. Such voltages pose a shock hazard.
- When using the probes, keep fingers away from probe contacts. Keep fingers behind the finger guards on the probes.
- Measurements can be adversely affected by impedances of additional operating circuits connected in parallel or by transient currents.
- Verify operation prior to measuring hazardous voltages (voltages above 30V ac rms, 42V ac peak and 60V dc).
- Do not use the phase Rotation indicator with any of the parts removed.
- Do not use the phase Rotation indicator around explosive gas, vapor, or dust.
- Do not use the meter in a wet environment.

Description



Meter Description

- 1. Test Lead alligator clips
- 2. Test lead input jacks
- 3. L1, L2, L3 display icons
- 4. Clockwise Rotation LCD Indicator R (right) and L (left) icons
- 5. Sequence grid

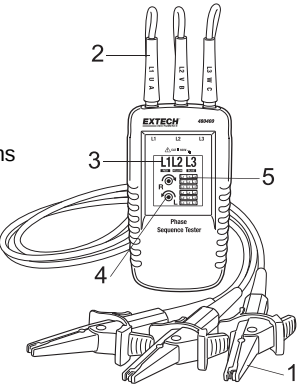

Display Description

- 1. Line designators (L1, L2, and L3)
- 2. Color codes for test leads
- 3. Clockwise / Counter-Clockwise indicator
- 4. LEFT (L) or RIGHT (R) rotation direction
- 5. Phase Sequence grid



Operation

Determine Phase Rotation Direction

- 1. Connect the supplied color-coded test leads to the meter's test lead input jacks at the top of the meter.
- 2. Connect the test probes to the three mains phases for the system under test.
- 3. L1, L2, and L3 indicators will illuminate one at a time, on the meter's LCD display, as each phase is connected.
- 4. The clockwise and counter-clockwise arrows with the left 'L' or right 'R' icons display the phase rotation direction of the device under test.
- 5. The Phase sequence grid (5) shows the three line sequences for Clockwise 'R' and the three line sequences for Counter-Clockwise 'L'.

Note: The rotational arrow indicators illuminate even if one of the test probes is connected to a neutral or ground conductor instead of one of the mains phases.

Specifications

Nominal Voltage	40 to 600 VAC
Frequency Range (fn)	15 to 400HZ
Current pickup	1 mA
Nominal Test current (in per phase)	1 mA
Maximum Operating Voltage (Ume)	600 V
Operating Temperature	32 to 104°F (0 to 40°C)
Type of protection	IP 40
Dimensions	(H x W x D): 5.1 x 2.7 x 1.3"(130 x 69 x 32mm)
Weight	4.6 oz (130g)
Approvals	CE (EU directives)
Safety	For indoor use and in accordance with the requirements for double insulation to EN/IEC 61010-1:2010 and EN 61010-2-030:2010 Overvoltage Category III 600V and Category IV 300V, Pollution Degree 2.

Two-year Warranty

FLIR Systems, Inc. warrants this Extech brand instrument to be free of defects in parts and workmanship for **two years** from date of shipment (a six-month limited warranty applies to sensors and cables). To view the full warranty text please visit:

Calibration and Repair Services

FLIR Systems, Inc. offers calibration and repair services for the Extech brand products we sell. We offer NIST traceable calibration for most of our products. Contact us for information on calibration and repair availability, refer to the contact information below. Annual calibrations should be performed to verify meter performance and accuracy. Product specifications are subject to change without notice. Please visit our website for the most up-to-date product information

Copyright © 2014-2020 FLIR Systems, Inc.

All rights reserved including the right of reproduction in whole or in part in any form