

722 Series

Electromechanical Hour Meter



Available with stainless steel bezel

The Model 722 provides an AC Hour Meter with an operating range of 90-264VAC 50/60 Hz. You no longer require two separate meters, one for 115VAC and one for 230VAC. Models are available in the standard industry housings, 2-Hole Rectangular, Flush-Rectangular, Flush-Round and 3-Hole Round. Its quartz time base insures accurate long-term time keeping. The totally sealed case protects against the environment and provides years of reliable service. All models are NEMA 4X,12 rated when mounted with optional gasket.

Key Features

- Operating voltage 90-264VAC 50/60Hz
- Totally Sealed
- UL/cUL Recognized, CE & RoHS Compliant
- 6 Figure, 99999.9
- Quartz accuracy
- Options include:
 - Wire leads
 - Gasket kit (for NEMA 4X, 12 rating)
 - Custom lens
 - Terminals up, down, straight

Applications


- Medical Equipment
- Control Panels
- Office Equipment
- Test Equipment

Specification

Figures	6 - digits, 0.14" [3.6mm] 99999.9 Hours and indicator - white on black Decimal - black on white
Reset	Non-reset
Voltage	90-264VAC
Frequency	50/60Hz
Power	1 watt max.
Mount	Clip or mounting holes
Terminations	1/4" [6.3mm] spade terminals
Weight	~2 oz [57 g]
Accuracy	± 0.02% over entire range
Case Material	Black polymer
Lens Material	Polymer
Approvals	UL/cUL Recognized, CE & RoHS Compliant, SAE & NEMA 4X, 12 Compliant
Environmental	Totally Sealed
Front Panel	NEMA 4X, 12 rated with optional gasket
Temp. Range	-40°F to +185°F [-40°C to + 85°C]
Humidity	95% (SAE J1378)
Vibration	10-80 Hz. 20g max. (SAE J1378)
Shock	55g @ 9 - 13msec (SAE J1378)


Dimensions

2-Hole



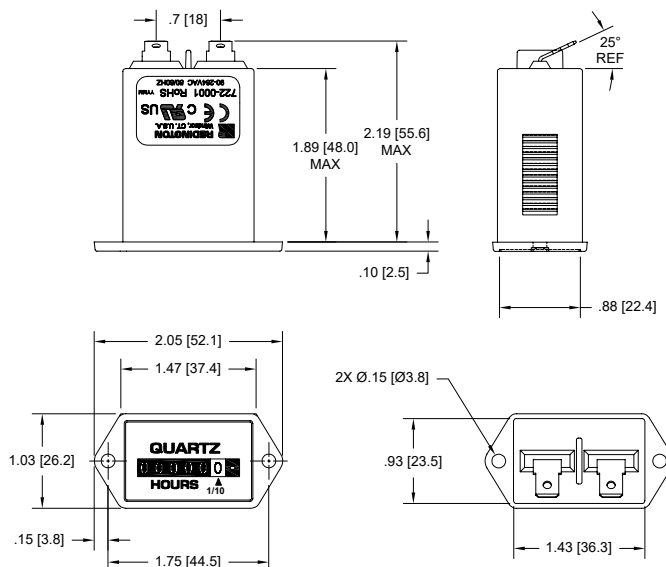


Panel Opening: 1.45" X 0.95" [36.8 X 24.1]

Flush-Rectangular

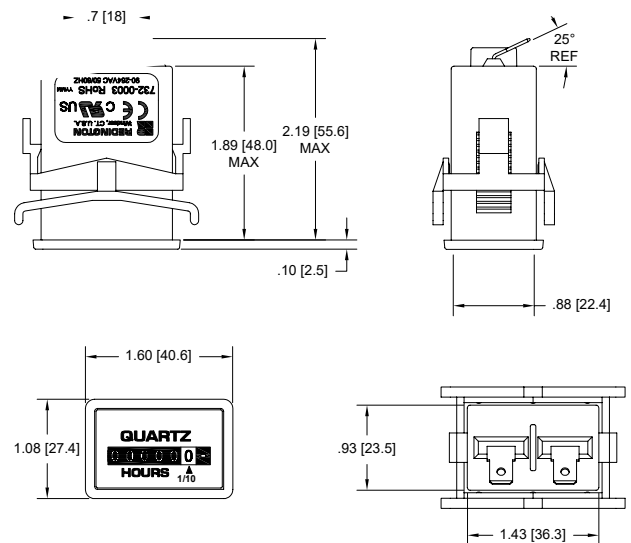

Panel Opening: 1.45" X 0.95" [36.8 X 24.1]
Panel Thickness: 0.02 to 0.03 to 0.04 to 0.05 to 0.06 to 0.07 to 0.08 to 0.09 to 0.10 to 0.11 to 0.12 to 0.13 to 0.14 to 0.15 to 0.16 to 0.17 to 0.18 to 0.19 to 0.20 to 0.21 to 0.22 to 0.23 to 0.24 to 0.25 to 0.26 to 0.27 to 0.28 to 0.29 to 0.30 to 0.31 to 0.32 to 0.33 to 0.34 to 0.35 to 0.36 to 0.37 to 0.38 to 0.39 to 0.40 to 0.41 to 0.42 to 0.43 to 0.44 to 0.45 to 0.46 to 0.47 to 0.48 to 0.49 to 0.50 to 0.51 to 0.52 to 0.53 to 0.54 to 0.55 to 0.56 to 0.57 to 0.58 to 0.59 to 0.60 to 0.61 to 0.62 to 0.63 to 0.64 to 0.65 to 0.66 to 0.67 to 0.68 to 0.69 to 0.70 to 0.71 to 0.72 to 0.73 to 0.74 to 0.75 to 0.76 to 0.77 to 0.78 to 0.79 to 0.80 to 0.81 to 0.82 to 0.83 to 0.84 to 0.85 to 0.86 to 0.87 to 0.88 to 0.89 to 0.90 to 0.91 to 0.92 to 0.93 to 0.94 to 0.95 to 0.96 to 0.97 to 0.98 to 0.99 to 1.00 to 1.01 to 1.02 to 1.03 to 1.04 to 1.05 to 1.06 to 1.07 to 1.08 to 1.09 to 1.10 to 1.11 to 1.12 to 1.13 to 1.14 to 1.15 to 1.16 to 1.17 to 1.18 to 1.19 to 1.20 to 1.21 to 1.22 to 1.23 to 1.24 to 1.25 to 1.26 to 1.27 to 1.28 to 1.29 to 1.30 to 1.31 to 1.32 to 1.33 to 1.34 to 1.35 to 1.36 to 1.37 to 1.38 to 1.39 to 1.40 to 1.41 to 1.42 to 1.43 to 1.44 to 1.45 to 1.46 to 1.47 to 1.48 to 1.49 to 1.50 to 1.51 to 1.52 to 1.53 to 1.54 to 1.55 to 1.56 to 1.57 to 1.58 to 1.59 to 1.60 to 1.61 to 1.62 to 1.63 to 1.64 to 1.65 to 1.66 to 1.67 to 1.68 to 1.69 to 1.70 to 1.71 to 1.72 to 1.73 to 1.74 to 1.75 to 1.76 to 1.77 to 1.78 to 1.79 to 1.80 to 1.81 to 1.82 to 1.83 to 1.84 to 1.85 to 1.86 to 1.87 to 1.88 to 1.89 to 1.90 to 1.91 to 1.92 to 1.93 to 1.94 to 1.95 to 1.96 to 1.97 to 1.98 to 1.99 to 2.00 to 2.01 to 2.02 to 2.03 to 2.04 to 2.05 to 2.06 to 2.07 to 2.08 to 2.09 to 2.10 to 2.11 to 2.12 to 2.13 to 2.14 to 2.15 to 2.16 to 2.17 to 2.18 to 2.19 to 2.20 to 2.21 to 2.22 to 2.23 to 2.24 to 2.25 to 2.26 to 2.27 to 2.28 to 2.29 to 2.30 to 2.31 to 2.32 to 2.33 to 2.34 to 2.35 to 2.36 to 2.37 to 2.38 to 2.39 to 2.40 to 2.41 to 2.42 to 2.43 to 2.44 to 2.45 to 2.46 to 2.47 to 2.48 to 2.49 to 2.50 to 2.51 to 2.52 to 2.53 to 2.54 to 2.55 to 2.56 to 2.57 to 2.58 to 2.59 to 2.60 to 2.61 to 2.62 to 2.63 to 2.64 to 2.65 to 2.66 to 2.67 to 2.68 to 2.69 to 2.70 to 2.71 to 2.72 to 2.73 to 2.74 to 2.75 to 2.76 to 2.77 to 2.78 to 2.79 to 2.80 to 2.81 to 2.82 to 2.83 to 2.84 to 2.85 to 2.86 to 2.87 to 2.88 to 2.89 to 2.90 to 2.91 to 2.92 to 2.93 to 2.94 to 2.95 to 2.96 to 2.97 to 2.98 to 2.99 to 3.00 to 3.01 to 3.02 to 3.03 to 3.04 to 3.05 to 3.06 to 3.07 to 3.08 to 3.09 to 3.10 to 3.11 to 3.12 to 3.13 to 3.14 to 3.15 to 3.16 to 3.17 to 3.18 to 3.19 to 3.20 to 3.21 to 3.22 to 3.23 to 3.24 to 3.25 to 3.26 to 3.27 to 3.28 to 3.29 to 3.30 to 3.31 to 3.32 to 3.33 to 3.34 to 3.35 to 3.36 to 3.37 to 3.38 to 3.39 to 3.40 to 3.41 to 3.42 to 3.43 to 3.44 to 3.45 to 3.46 to 3.47 to 3.48 to 3.49 to 3.50 to 3.51 to 3.52 to 3.53 to 3.54 to 3.55 to 3.56 to 3.57 to 3.58 to 3.59 to 3.60 to 3.61 to 3.62 to 3.63 to 3.64 to 3.65 to 3.66 to 3.67 to 3.68 to 3.69 to 3.70 to 3.71 to 3.72 to 3.73 to 3.74 to 3.75 to 3.76 to 3.77 to 3.78 to 3.79 to 3.80 to 3.81 to 3.82 to 3.83 to 3.84 to 3.85 to 3.86 to 3.87 to 3.88 to 3.89 to 3.90 to 3.91 to 3.92 to 3.93 to 3.94 to 3.95 to 3.96 to 3.97 to 3.98 to 3.99 to 4.00 to 4.01 to 4.02 to 4.03 to 4.04 to 4.05 to 4.06 to 4.07 to 4.08 to 4.09 to 4.10 to 4.11 to 4.12 to 4.13 to 4.14 to 4.15 to 4.16 to 4.17 to 4.18 to 4.19 to 4.20 to 4.21 to 4.22 to 4.23 to 4.24 to 4.25 to 4.26 to 4.27 to 4.28 to 4.29 to 4.30 to 4.31 to 4.32 to 4.33 to 4.34 to 4.35 to 4.36 to 4.37 to 4.38 to 4.39 to 4.40 to 4.41 to 4.42 to 4.43 to 4.44 to 4.45 to 4.46 to 4.47 to 4.48 to 4.49 to 4.50 to 4.51 to 4.52 to 4.53 to 4.54 to 4.55 to 4.56 to 4.57 to 4.58 to 4.59 to 4.60 to 4.61 to 4.62 to 4.63 to 4.64 to 4.65 to 4.66 to 4.67 to 4.68 to 4.69 to 4.70 to 4.71 to 4.72 to 4.73 to 4.74 to 4.75 to 4.76 to 4.77 to 4.78 to 4.79 to 4.80 to 4.81 to 4.82 to 4.83 to 4.84 to 4.85 to 4.86 to 4.87 to 4.88 to 4.89 to 4.90 to 4.91 to 4.92 to 4.93 to 4.94 to 4.95 to 4.96 to 4.97 to 4.98 to 4.99 to 5.00 to 5.01 to 5.02 to 5.03 to 5.04 to 5.05 to 5.06 to 5.07 to 5.08 to 5.09 to 5.10 to 5.11 to 5.12 to 5.13 to 5.14 to 5.15 to 5.16 to 5.17 to 5.18 to 5.19 to 5.20 to 5.21 to 5.22 to 5.23 to 5.24 to 5.25 to 5.26 to 5.27 to 5.28 to 5.29 to 5.30 to 5.31 to 5.32 to 5.33 to 5.34 to 5.35 to 5.36 to 5.37 to 5.38 to 5.39 to 5.40 to 5.41 to 5.42 to 5.43 to 5.44 to 5.45 to 5.46 to 5.47 to 5.48 to 5.49 to 5.50 to 5.51 to 5.52 to 5.53 to 5.54 to 5.55 to 5.56 to 5.57 to 5.58 to 5.59 to 5.60 to 5.61 to 5.62 to 5.63 to 5.64 to 5.65 to 5.66 to 5.67 to 5.68 to 5.69 to 5.70 to 5.71 to 5.72 to 5.73 to 5.74 to 5.75 to 5.76 to 5.77 to 5.78 to 5.79 to 5.80 to 5.81 to 5.82 to 5.83 to 5.84 to 5.85 to 5.86 to 5.87 to 5.88 to 5.89 to 5.90 to 5.91 to 5.92 to 5.93 to 5.94 to 5.95 to 5.96 to 5.97 to 5.98 to 5.99 to 6.00 to 6.01 to 6.02 to 6.03 to 6.04 to 6.05 to 6.06 to 6.07 to 6.08 to 6.09 to 6.10 to 6.11 to 6.12 to 6.13 to 6.14 to 6.15 to 6.16 to 6.17 to 6.18 to 6.19 to 6.20 to 6.21 to 6.22 to 6.23 to 6.24 to 6.25 to 6.26 to 6.27 to 6.28 to 6.29 to 6.30 to 6.31 to 6.32 to 6.33 to 6.34 to 6.35 to 6.36 to 6.37 to 6.38 to 6.39 to 6.40 to 6.41 to 6.42 to 6.43 to 6.44 to 6.45 to 6.46 to 6.47 to 6.48 to 6.49 to 6.50 to 6.51 to 6.52 to 6.53 to 6.54 to 6.55 to 6.56 to 6.57 to 6.58 to 6.59 to 6.60 to 6.61 to 6.62 to 6.63 to 6.64 to 6.65 to 6.66 to 6.67 to 6.68 to 6.69 to 6.70 to 6.71 to 6.72 to 6.73 to 6.74 to 6.75 to 6.76 to 6.77 to 6.78 to 6.79 to 6.80 to 6.81 to 6.82 to 6.83 to 6.84 to 6.85 to 6.86 to 6.87 to 6.88 to 6.89 to 6.90 to 6.91 to 6.92 to 6.93 to 6.94 to 6.95 to 6.96 to 6.97 to 6.98 to 6.99 to 7.00 to 7.01 to 7.02 to 7.03 to 7.04 to 7.05 to 7.06 to 7.07 to 7.08 to 7.09 to 7.10 to 7.11 to 7.12 to 7.13 to 7.14 to 7.15 to 7.16 to 7.17 to 7.18 to 7.19 to 7.20 to 7.21 to 7.22 to 7.23 to 7.24 to 7.25 to 7.26 to 7.27 to 7.28 to 7.29 to 7.30 to 7.31 to 7.32 to 7.33 to 7.34 to 7.35 to 7.36 to 7.37 to 7.38 to 7.39 to 7.40 to 7.41 to 7.42 to 7.43 to 7.44 to 7.45 to 7.46 to 7.47 to 7.48 to 7.49 to 7.50 to 7.51 to 7.52 to 7.53 to 7.54 to 7.55 to 7.56 to 7.57 to 7.58 to 7.59 to 7.60 to 7.61 to 7.62 to 7.63 to 7.64 to 7.65 to 7.66 to 7.67 to 7.68 to 7.69 to 7.70 to 7.71 to 7.72 to 7.73 to 7.74 to 7.75 to 7.76 to 7.77 to 7.78 to 7.79 to 7.80 to 7.81 to 7.82 to 7.83 to 7.84 to 7.85 to 7.86 to 7.87 to 7.88 to 7.89 to 7.90 to 7.91 to 7.92 to 7.93 to 7.94 to 7.95 to 7.96 to 7.97 to 7.98 to 7.99 to 8.00 to 8.01 to 8.02 to 8.03 to 8.04 to 8.05 to 8.06 to 8.07 to 8.08 to 8.09 to 8.10 to 8.11 to 8.12 to 8.13 to 8.14 to 8.15 to 8.16 to 8.17 to 8.18 to 8.19 to 8.20 to 8.21 to 8.22 to 8.23 to 8.24 to 8.25 to 8.26 to 8.27 to 8.28 to 8.29 to 8.30 to 8.31 to 8.32 to 8.33 to 8.34 to 8.35 to 8.36 to 8.37 to 8.38 to 8.39 to 8.40 to 8.41 to 8.42 to 8.43 to 8.44 to 8.45 to 8.46 to 8.47 to 8.48 to 8.49 to 8.50 to 8.51 to 8.52 to 8.53 to 8.54 to 8.55 to 8.56 to 8.57 to 8.58 to 8.59 to 8.60 to 8.61 to 8.62 to 8.63 to 8.64 to 8.65 to 8.66 to 8.67 to 8.68 to 8.69 to 8.70 to 8.71 to 8.72 to 8.73 to 8.74 to 8.75 to 8.76 to 8.77 to 8.78 to 8.79 to 8.80 to 8.81 to 8.82 to 8.83 to 8.84 to 8.85 to 8.86 to 8.87 to 8.88 to 8.89 to 8.90 to 8.91 to 8.92 to 8.93 to 8.94 to 8.95 to 8.96 to 8.97 to 8.98 to 8.99 to 9.00 to 9.01 to 9.02 to 9.03 to 9.04 to 9.05 to 9.06 to 9.07 to 9.08 to 9.09 to 9.10 to 9.11 to 9.12 to 9.13 to 9.14 to 9.15 to 9.16 to 9.17 to 9.18 to 9.19 to 9.20 to 9.21 to 9.22 to 9.23 to 9.24 to 9.25 to 9.26 to 9.27 to 9.28 to 9.29 to 9.30 to 9.31 to 9.32 to 9.33 to 9.34 to 9.35 to 9.36 to 9.37 to 9.38 to 9.39 to 9.40 to 9.41 to 9.42 to 9.43 to 9.44 to 9.45 to 9.46 to 9.47 to 9.48 to 9.49 to 9.50 to 9.51 to 9.52 to 9.53 to 9.54 to 9.55 to 9.56 to 9.57 to 9.58 to 9.59 to 9.60 to 9.61 to 9.62 to 9.63 to 9.64 to 9.65 to 9.66 to 9.67 to 9.68 to 9.69 to 9.70 to 9.71 to 9.72 to 9.73 to 9.74 to 9.75 to 9.76 to 9.77 to 9.78 to 9.79 to 9.80 to 9.81 to 9.82 to 9.83 to 9.84 to 9.85 to 9.86 to 9.87 to 9.88 to 9.89 to 9.90 to 9.91 to 9.92 to 9.93 to 9.94 to 9.95 to 9.96 to 9.97 to 9.98 to 9.99 to 10.00 to 10.01 to 10.02 to 10.03 to 10.04 to 10.05 to 10.06 to 10.07 to 10.08 to 10.09 to 10.10 to 10.11 to 10.12 to 10.13 to 10.14 to 10.15 to 10.16 to 10.17 to 10.18 to 10.19 to 10.20 to 10.21 to 10.22 to 10.23 to 10.24 to 10.25 to 10.26 to 10.27 to 10.28 to 10.29 to 10.30 to 10.31 to 10.32 to 10.33 to 10.34 to 10.35 to 10.36 to 10.37 to 10.38 to 10.39 to 10.40 to 10.41 to 10.42 to 10.43 to 10.44 to 10.45 to 10.46 to 10.47 to 10.48 to 10.49 to 10.50 to 10.51 to 10.52 to 10.53 to 10.54 to 10.55 to 10.56 to 10.57 to 10.58 to 10.59 to 10.60 to 10.61 to 10.62 to 10.63 to 10.64 to 10.65 to 10.66 to 10.67 to 10.68 to 10.69 to 10.70 to 10.71 to 10.72 to 10.73 to 10.74 to 10.75 to 10.76 to 10.77 to 10.78 to 10.79 to 10.80 to 10.81 to 10.82 to 10.83 to 10.84 to 10.85 to 10.86 to 10.87 to 10.88 to 10.89 to 10.90 to 10.91 to 10.92 to 10.93 to 10.94 to 10.95 to 10.96 to 10.97 to 10.98 to 10.99 to 11.00 to 11.01 to 11.02 to 11.03 to 11.04 to 11.05 to 11.06 to 11.07 to 11.08 to 11.09 to 11.10 to 11.11 to 11.12 to 11.13 to 11.14 to 11.15 to 11.16 to 11.17 to 11.18 to 11.19 to 11.20 to 11.21 to 11.22 to 11.23 to 11.24 to 11.25 to 11.26 to 11.27 to 11.28 to 11.29 to 11.30 to 11.31 to 11.32 to 11.33 to 11.34 to 11.35 to 11.36 to 11.37 to 11.38 to 11.39 to 11.40 to 11.41 to 11.42 to 11.43 to 11.44 to 11.45 to 11.46 to 11.47 to 11.48 to 11.49 to 11.50 to 11.51 to 11.52 to 11.53 to 11.54 to 11.55 to 11.56 to 11.57 to 11.58 to 11.59 to 11.60 to 11.61 to 11.62 to 11.63 to 11.64 to 11.65 to 11.66 to 11.67 to 11.68 to 11.69 to 11.70 to 11.71 to 11.72 to 11.73 to 11.74 to 11.75 to 11.76 to 11.77 to 11.78 to 11.79 to 11.80 to 11.81 to 11.82 to 11.83 to 11.84 to 11.85 to 11.86 to 11.87 to 11.88 to 11.89 to 11.90 to 11.91 to 11.92 to 11.93 to 11.94 to 11.95 to 11.96 to 11.97 to 11.98 to 11.99 to 12.00 to 12.01 to 12.02 to 12.03 to 12.04 to 12.05 to 12.06 to 12.07 to 12.08 to 12.09 to 12.10 to 12.11 to 12.12 to 12.13 to 12.14 to 12.15 to 12.16 to 12.17 to 12.18 to 12.19 to 12.20 to 12.21 to 12.22 to 12.23 to 12.24 to 12.25 to 12.26 to 12.27 to 12.28 to 12.29 to 12.30 to 12.31 to 12.32 to 12.33 to 12.34 to 12.35 to 12.36 to 12.37 to 12.38 to 12.39 to 12.40 to 12.41 to 12.42 to 12.43 to 12.44 to 12.45 to 12.46 to 12.47 to 12.48 to 12.49 to 12.50 to 12.51 to 12.52 to 12.53 to 12.54 to 12.55 to 12.56 to 12.57 to 12.58 to 12.59 to 12.60 to 12.61 to 12.62 to 12.63 to 12.64 to 12.65 to 12.66 to 12.67 to 12.68 to 12.69 to 12.70 to 12.71 to 12.72 to 12.73 to 12.74 to 12.75 to 12.76 to 12.77 to 12.78 to 12.79 to 12.80 to 12.81 to 12.82 to 12.83 to 12.84 to 12.85 to 12.86 to 12.87 to 12.88 to 12.89 to 12.90 to 12.91 to 12.92 to 12.93 to 12.94 to 12.95 to 12.96 to 12.97 to 12.98 to 12.99 to 13.00 to 13.01 to 13.02 to 13.03 to 13.04 to 13.05 to 13.06 to 13.07 to 13.08 to 13.09 to 13.10 to 13.11 to 13.12 to 13.13 to 13.14 to 13.15 to 13.16 to 13.17 to 13.18 to 13.19 to 13.20 to 13.21 to 13.22 to 13.23 to 13.24 to 13.25 to 13.26 to 13.27 to 13.28 to 13.29 to 13.30 to 13.31 to 13.32 to 13.33 to 13.34 to 13.35 to 13.36 to 13.37 to 13.38 to 13.39 to 13.40 to 13.41 to 13.42 to 13.43 to 13.44 to 13.45 to 13.46 to 13.47 to 13.48 to 13.49 to 13.50 to 13.51 to 13.52 to 13.53 to 13.54 to 13.55 to 13.56 to 13.57 to 13.58 to 13.59 to 13.60 to 13.61 to 13.62 to 13.63 to 13.64 to 13.65 to 13.66 to 13.67 to 13.68 to 13.69 to 13.70 to 13.71 to 13.72 to 13.73 to 13.74 to 13.75 to 13.76 to 13.77 to 13.78 to 13.79 to 13.80 to 13.81 to 13.82 to 13.83 to 13.84 to 13.85 to 13.86 to 13.87 to 13.88 to 13.89 to 13.90 to 13.91 to 13.92 to 13.93 to 13.94 to 13.95 to 13.96 to 13.97 to 13.98 to 13.99 to 14.00 to 14.01 to 14.02 to 14.03 to 14.04 to 14.05 to 14.06 to 14.07 to 14.08 to 14.09 to 14.10 to 14.11 to 14.12 to 14.13 to 14.14 to 14.15 to 14.16 to 14.17 to 14.18 to 14.19 to 14.20 to 14.21 to 14.22 to 14.23 to 14.24 to 14.25 to 14.26 to 14.27 to 14.28 to 14.29 to 14.30 to 14.31 to 14.32 to 14.33 to 14.34 to 14.35 to 14.36 to 14.37 to 14.38 to 14.39 to 14.40 to 14.41 to 14.42 to 14.43 to 14.44 to 14.45 to 14.46 to 14.47 to 14.48 to 14.49 to 14.50 to 14.51 to 14.52 to 14.53 to 14.54 to 14.55 to 14.56 to 14.57 to 14.58 to 14.59 to 14.60 to 14.61 to 14.62 to 14.63 to 14.64 to 14.65 to 14.66 to 14.67 to 14.68 to 14.69 to 14.70 to 14.71 to 14.72 to 14.73 to 14.74 to 14.75 to 14.76 to 14.77 to 14.78 to 14.79 to 14.80 to 14.81 to 14.82 to 14.83 to 14.84 to 14.85 to 14.86 to 14.87 to 14.88 to 14.89 to 14.90 to 14.91 to 14.92 to 14.93 to 14.94 to 14.95 to 14.96 to 14.97 to 14.98 to 14.99 to 15.00 to 15.01 to 15.02 to 15.03 to 15.04 to 15.05 to 15.06 to 15.07 to 15.08 to 15.09 to 15.10 to 15.11 to 15.12 to 15.13 to 15.14 to 15.15 to 15.16 to 15.17 to 15.18 to 15.19 to 15.20 to 15.21 to 15.22 to 15.23 to 15.24 to 15.25 to 15.26 to 15.27 to 15.28 to 15.29 to 15.30 to 15.31 to 15.32 to 15.33 to 15.34 to 15.35 to 15.36 to 15.37 to 15.38 to 15.39 to 15.40 to 15.41 to 15.42 to 15.43 to 15.44 to 15.45 to 15.46 to 15.47 to 15.48 to 15.49 to 15.50 to 15.51 to 15.52 to 15.53 to 15.54 to 15.55 to 15.56 to 15.57 to 15.58 to 15.59 to 15.60 to 15.61 to 15.62 to 15.63 to 15.64 to 15.65 to 15.66 to 15.67 to 15.68 to 15.69 to 15.70 to 15.71 to 15.72 to 15.73 to 15.74 to 15.75 to 15.76 to 15.77 to 15.78 to 15.79 to 15.80 to 15.81 to 15.82 to 15.83 to 15.84 to 15.85 to 15.86 to 15.87 to 15.88 to 15.89 to 15.90 to 15.91 to 15.92 to 15.93 to 15.94 to 15.95 to 15.96 to 15.97 to 15.98 to 15.99 to 16.00 to 16.01 to 16.02 to 16.03 to 16.04 to 16.05 to 16.06 to 16.07 to 16.08 to 16.09 to 16.10 to 16.11 to 16.12 to 16.13 to 16.14 to 16.15 to 16.16 to 16.17 to 16.18 to 16.19 to 16.20 to 16.21 to 16.22 to 16.23 to 16.24 to 16.25 to 16.26 to 16.27 to 16.28 to 16.29 to 16.30 to 16.31 to 16.32 to 16.33 to 16.34 to 16.35 to 16.36 to 16.37 to 16.38 to 16.39 to 16.40 to 16.41 to 16.42 to 16.43 to 16.44 to 16.45 to 16.46 to 16.47 to 16.48 to 16.49 to 16.50 to 16.51 to 16.52 to 16.53 to 16.54 to 16.55 to 16.56 to 16.57 to 16.58 to 16.59 to 16.60 to 16.61 to 16.62 to 16.63 to 16.64 to 16.65 to 16.66 to 16.67 to 16.68 to 16.69 to 16.70 to 16.71 to 16.72 to 16.73 to 16.74 to 16.75 to 16.76 to 16.77 to 16.78 to 16.79 to 16.80 to 16.81 to 16.82 to 16.83 to 16.84 to 16.85 to 16.86 to 16.87 to 16.88 to 16.89 to 16.90 to 16.91 to 16.92 to 16.93 to 16.94 to 16.95 to 16.96 to 16.

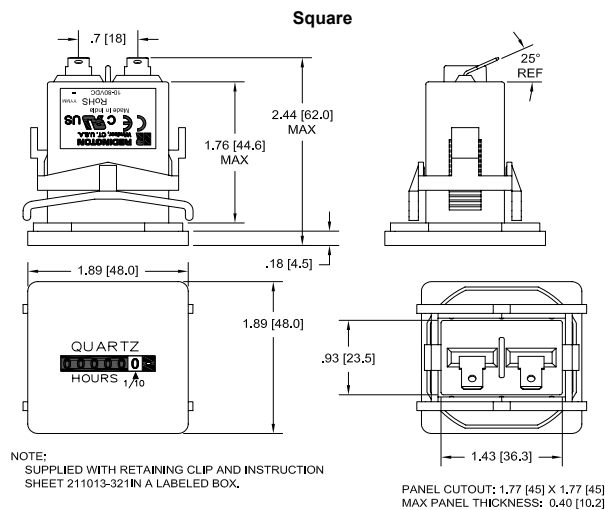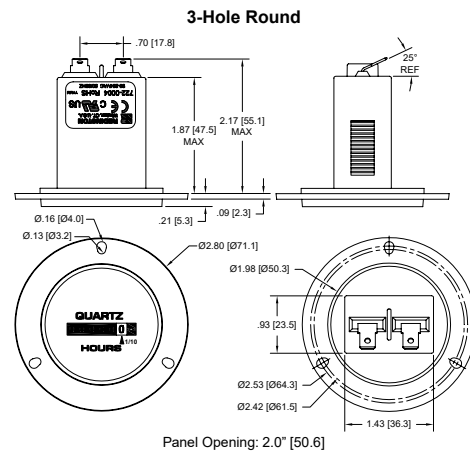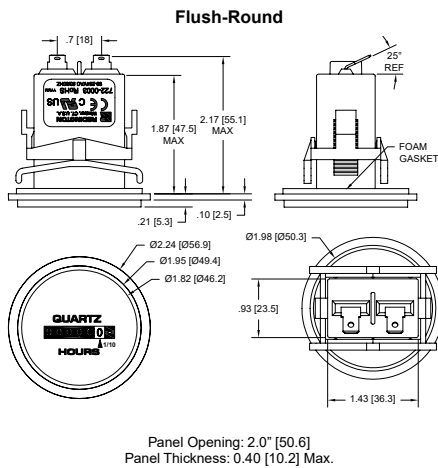

Part Numbers

722-0001	2-Hole Rectangular, 90-264VAC 50/60Hz, ¼" [6.3mm] spade terminals, hours & 1/10's
722-0002	Flush-Rectangular, 90-264VAC 50/60Hz, ¼" [6.3mm] spade terminals, hours & 1/10's
722-0003	Flush-Round, 90-264VAC 50/60Hz, ¼" [6.3mm] spade terminals, hours & 1/10's
722-0004	3-Hole Round, 90-264VAC 50/60Hz, ¼" [6.3mm] spade terminals, hours & 1/10's
722-0030	Square 1.9", 90-264VAC 50/60Hz, ¼" [6.3mm] spade terminals, hours & 1/10's
5003-010	NEMA 4X, 12 Gasket for Model 722-0001
5003-009	NEMA 4X, 12 Gasket for Model 722-0002
5003-008	NEMA 4X, 12 Gasket for Model 722-0003
5003-011	NEMA 4X, 12 Gasket for Model 722-0004

