



Indoor Air Quality Meter

## INTRODUCTION

Thank you for purchasing the UEi AQM4 IAQ meter. The meter measures CO<sub>2</sub> levels, CO levels, air temperature, dew point, wet bulb temperature, and humidity. The AQM4 is an ideal instrument for indoor air quality (IAQ) diagnosis.

Poor indoor air quality causes tiredness, inability to concentrate, and even illness (ex. Sick Building Syndrome). IAQ monitoring and surveying especially for CO<sub>2</sub> levels and air ventilation has become widely applied in public offices, classrooms, factories, hospitals, and hotels. It is also recommended for regulating standards of industrial air quality in some countries.

The portable AQM4 uses NDIR (non-dispersive infrared) technology for CO<sub>2</sub> measurement to ensure reliability and long-term stability. It is useful in verifying HVAC systems performance and air ventilation control.

CO is a colorless, odorless, and tasteless gas which is slightly lighter than air. It is highly toxic to humans and animals. Carbon Monoxide is measured using a long-life electrochemical sensor.

Maximum indoor air quality CO level per ASHRAE Residential standards 62-1989 for living area is under 9ppm. It is necessary to evacuate employees from enclosed spaces if the CO concentration exceeds 100ppm per OSHA exposure limit.

## FEATURES

- Large LCD display with blue backlight for use in dark areas
- One touch to display CO<sub>2</sub> / dew point / temperature / wet bulb temperature / air temperature / humidity / CO in sequence
- Designed with NDIR waveguide technology CO<sub>2</sub> sensor
- Programmable CO level alarm
- Extended drift compensation on CO<sub>2</sub> sensor
- Audible alarm (~ 80db) threshold setting
- Max and Min functions included (TWA and STEL for CO<sub>2</sub> only)
- Mini USB to PC download function for analysis
- 99 points manual recording
- 8000 points auto recording
- Review 99 points manual record from meter
- Hold function freezes current readings
- Housing designed to help air ventilation for quick and accurate response.
- Easy to manually calibrate CO<sub>2</sub> to fresh air (380-420ppm)

## MATERIAL SUPPLIED

This package contains:

- Meter
- 4 AA batteries
- Mini USB cable and software CD
- Operation manual
- Hard carrying case
- 33% calibration salt
- 75% calibration salt
- AC Power Adapter

## POWER SUPPLY

The meter is powered by either 4 AA batteries or a DC adaptor (9V/1A output.)

Install the batteries into the battery compartment on the rear of the instrument. Verify correct polarity and solid contact. When an adaptor is used, it will cut off the power supply from the batteries. The adaptor can not be used as a battery charger.

When battery voltage gets low, **B** will appear on the LCD (Fig. 1.) The CO<sub>2</sub> sensor accuracy is compromised under low batteries, replace with fresh batteries or connect to an adaptor.

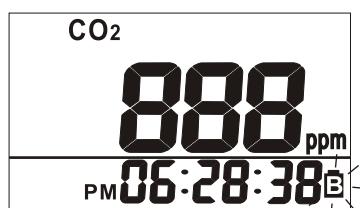


Fig.1

## LCD DISPLAY



## SYMBOLS

Primary LCD	Measured and calculated values
Secondary LCD	Real time clock
CO <sub>2</sub>	Carbon dioxide reading
CO	Carbon monoxide reading
HOLD	Readings are frozen
MIN/MAX	Minimum/maximum readings
STEL	Short-term exposure limit (15 minutes weighted average)*
TWA	Time weighted average (8 hours)*
 B	Low battery indicator
DP	Dew point temperature
TA	Air temperature
WBT	Wet bulb temperature
%RH	Percentage of relative humidity
°C/°F	Celsius/Fahrenheit scale
CAL	In calibration status
REC	In manual/automatic logging
RECALL	In manual records recall mode

\*CO<sub>2</sub> Only

## KEYPAD

 Turns the meter on or off.  
Press and hold to enter setup mode while meter is off.  
Press  while turning the meter on to disable auto power off.

 Exits setup/recall page. Press and hold to start automatic logging.

 Press to switch display mode.  
Press and hold to enter memory recall mode.

### KEYPAD CONT.

-  Freezes the current readings. Selects unit or increases value in setup. Cancels data hold function.
-  Press to manually record the reading. Selects unit or decreases value in setup.
-  Displays MIN, MAX, TWA, STEL function. Saves and finishes settings while in sleep mode.

### OPERATION

#### POWER ON/OFF

Press  to turn the meter on and off. At power up, the meter emits a short beep and begins 30 second warm-up countdown (Fig. 2), then enters normal mode with current CO<sub>2</sub> and real time displays (Fig.3).

#### NOTE:

THE REAL TIME DISPLAYS DATE (YY-MM-DD) AND TIME IN SEQUENCE.



Fig.2



Fig.3

#### TAKING MEASUREMENT

The meter starts measurements when powered on and updates readings every second. In the condition of an operating environment change, (ex. high to low temp) it takes 30 seconds for the CO<sub>2</sub> sensor to respond and 30 minutes for RH sensor.

**NOTE:** DO NOT HOLD THE METER IN CLOSE PROXIMITY TO THE FACE AS EXHALED BREATH AFFECTS CO<sub>2</sub> LEVELS.

### CO<sub>2</sub> (CARBON DIOXIDE)

Press  to switch the mode to CO<sub>2</sub>. CO<sub>2</sub> concentration will display in ppm on primary display (Fig. 4). The lower display shows the real time clock.



Fig.4

### AIR, (DP, WBT, TA ) TEMPERATURES

Press  to switch to temperature display (Fig. 5). In the AQM4, dew point temperature and wet bulb temperature are also available by repeated pressing of  (Fig 6). The lower display shows the real time clock.



Fig.5



Fig.6

### HUMIDITY

Press  to switch to humidity display (Fig. 7). The lower display shows the real time clock.



Fig.7



Fig.8

### CO (CARBON MONOXIDE)

Press  to switch the mode to CO. CO concentration will display in ppm on primary display (Fig. 8). The lower display shows the real time clock.

### DATA HOLD

In normal display mode, press  to freeze the readings, the "HOLD" icon is displayed on the left top of the LCD (Fig. 9). All current readings are kept unchanged. Press  to cycle through all held readings.



While in "HOLD" mode, STEL and TWA will continue updating every 5 minutes.

### BACKLIGHT

The backlight will be activated for 10 seconds by pressing any key.

### MIN, MAX, STEL, TWA

This meter allows you to check the minimum and maximum, STEL and TWA values calculated since power on. Under normal mode, press  to see the minimum, maximum, STEL and TWA and real time sequence. Each press of , displays MIN, MAX, STEL, TWA in sequence and returns to current value (Fig 10 - 13). STEL and TWA values are calculated for CO<sub>2</sub> only.

If the meter is turned on for less than 15 minutes, the STEL value will be the weighted average of readings taken since power on. This is also true for TWA values displayed prior to 8 hours. It takes at least 5 minutes to calculate STEL and TWA. The display shows "----" during the first 5 minutes from power on.

In the MAX/MIN/STEL/TWA modes, it shows the corresponding readings on the main display and the real time clock on the lower display.

In this mode, press  to switch the displayed parameters (Fig 14).

The displayed sequence in this mode is MIN MAX STEL TWA. Press  key to return to live readings.

"**HOLD**", "Manually Record", "Record" and "Recall" functions are all available when meter is in MIN/MAX/AVG mode.

To clear the MIN/MAX/AVG since power on, restart the meter or press  for more than 2 seconds to clear previous data and restart.



Fig.10



Fig.11



Fig.12



Fig.13




Fig.14

**NOTE:**  
TWA & STEL ARE FOR CO<sub>2</sub> ONLY. MIN/MAX ARE FOR ALL PARAMETERS

### MANUALLY RECORDING

The meter features 99 manual memory locations.

In normal or hold mode, press  key to record, **REC** icon and main display flash for about 3 seconds. The main display shows the memory serial number. The AQM4 has 99 locations. (Fig. 15)

**Each memory contains all parameters (CO<sub>2</sub>, CO, TA....%rh), not limited to the selected parameter on the main display.**



Fig.15

If the reading changes quickly, press  to freeze the reading before manually recording the data.

### 99 MEMORIES RECALL

In normal or hold mode, press  key for more than 2 seconds until the **Recall** icon flashes.

Press  or  to scroll through the memory locations. The memory serial number displays on the main LCD first and then readings stored in that location. (Fig. 16 & 17)




Fig.16




Fig.17

Press **MODE RECALL** key to switch the display parameter. (Fig. 18)




Fig.18

The time displayed in memory recall mode is the recording time of this memory.

To escape the memory recall mode, press **START ESC** key to leave and return to normal display.

#### ALARM

The meter features an audible alarm to give warnings when CO concentration exceeds a pre-set limit. (See Pg 12, P20 for setting alarm threshold.) It emits beeps (Abt. 80dB) when CO level goes over the set value and stops only when the readings fall below the set value. It beeps again when value goes over the limit.

The meter can automatically record readings of CO<sub>2</sub>/CO/TEMPERATURE/RH for extended environment monitoring. The memory capacity is 8,000 points. Users can set up sampling rate from 1 second to 4 hours, 59 minutes and 59 seconds. (See pg 11, P40)

After sampling rate is selected, press **START ESC** for 2 seconds under normal mode to start logging. The **REC** icon flashes to indicate the logging status and LCD main display shows the real time CO<sub>2</sub> measured value. Lower display is the real time clock. (Fig. 19)




Fig.19

To terminate data logging, press  for 2 seconds, until **REC** icon stops flashing.

**NOTE:**

The AQM4 will only record one session. If **REC** is activated all previous data is erased. Download logged data prior to starting another **REC** session.

**AUTO POWER OFF**

The meter turns off automatically after 20 minutes of inactivity. To override the function, hold down  and  for 2 seconds to turn on the meter until "n" appears. (Fig. 20)

**NOTE:**

AUTO SLEEP  
FUNCTION WILL BE  
DISABLED DURING  
CALIBRATION MODE




Fig.20

**SETUP**

When the meter is off, hold down  for more than 1 second to enter setup mode. (Fig 21) To exit setup, press  to return to normal mode.




Fig.21

Press  or  to scroll through set-up options from the following:

P10 - 99 Memory Clear  
P20 - CO Alarm  
P30 - Temperature Units  
P40 - Logging Sample Rate  
P50 - Pressure Compensation  
P60 - Real Time Clock

#### **P10: 99 MEMORIES CLEAR**

P10 and "CLR" (Fig. 21) are displayed on the LCD, press  to enter into P11 and clear or keep all the manual records. The current setting will be blinking on the LCD. (Fig. 22)

Press  or  to choose NO or YES and press  to confirm.



Fig.22

**-OR-** Press  to escape and return to P10

#### **P20: CO ALARM**

When P20 and "ALAR" (Fig. 23) are displayed on LCD, press  to enter into P21 for setting CO alarm threshold. The current set value will be blinking on the LCD (Fig 24). Press  to increase or  to decrease the value. The selectable alarm limits are 25~200ppm in 5 ppm increments. When the preferred alarm value is set, press  to save the setting

**-OR-** Press  without saving and return to P20.



Fig.23




Fig.24

### P30 TEMPERATURE UNIT

When P30 and "UNIT" (Fig 25) are displayed on the LCD, press  to go into P31 to choose the temperature unit.

The set value will display on LCD (Fig 26)

Press  or  to choose C° or F° and press  to confirm.



Fig.25



Fig.26

-OR- Press  to escape and return to P30.

### P40: LOGGING SAMPLING RATE

P40 allows you to set sampling rate of data logging (Fig. 27). The range is from 1 second to 4 hours 59 minutes and 59 seconds.

Press  to display current setting and enter edit mode. The display is in the format [HH. MM. SS.] The hour digits will be flashing. To change intervals between logged readings, press  to increase and  to decrease. Press  again to confirm and enter minute setting. Press  to confirm and enter seconds setting. (Fig 28) Press  to confirm the rate setting.

-OR- Press  to escape and return to P40.



Fig.27



Fig.28

### P50 PRESSURE COMPENSATION

When P50 and "PRES" (Fig. 29) are displayed on the LCD, press  to set pressure compensation value for CO<sub>2</sub> measurement. The current set will flash on LCD. (Fig. 30) The barometric pressure unit is kPa.



Fig.29




Fig.30

Press  to increase or  to decrease barometric pressure.

**-OR-** Press  to escape and return to P50.

**NOTE:** ONLY ENTER THIS MODE IF CURRENT BAROMETER PRESSURE IS KNOWN. MULTIPLY IN. Hg BY 3.39 TO OBTAIN kPa VALUE.

### P60: REAL TIME CLOCK

Enter P60 for setting the real time clock of this meter. Press  to enter into P61 to set the time format as 12 hour or 24 hour. The current set will flash on LCD. Press  or  to change the format and press  to confirm and continue to set the date and time. (Fig. 32)

**-OR-** Press  to escape and return to P60.

**NOTE:** DATE FORMAT IS YY:MM:DD.

The date will show on the lower display with year digits blinking. Press  to increase or  to decrease digits. Press  to confirm and continue to next setting. Repeat above steps to complete the year/month/day/hour/minute/second setting. (Fig. 32)



Fig.31



Fig.32

## CALIBRATION MODE

The AQM4 allows you to calibrate CO<sub>2</sub> and RH, for CO calibration please send unit to UEi. To enter calibration mode, place unit at suitable calibration site specified in the following sections.

Press  + , then also  simultaneously for 3 seconds to turn on the meter and enter calibration mode (Fig. 33). Press  or  to select parameter to calibrate. To cancel or exit calibration at any time, turn meter off.

**NOTE:**

ENSURE THE BATTERIES ARE AT FULL VOLTAGE BEFORE THE CALIBRATION TO PREVENT INTERRUPTION OR FAILED CALIBRATION.

## CO<sub>2</sub> CALIBRATION

The manual calibration is suggested to be done in sunny outdoor air that is well ventilated. To begin, enter calibration mode. Press  or  to select parameters for calibration and press enter. The meter is calibrated at standard 400ppm CO<sub>2</sub> concentration at the factory. It is suggested to manually calibrate regularly to maintain good accuracy.

**NOTE:**

WHEN THE ACCURACY BECOMES A CONCERN, RETURN TO UEI FOR STANDARD CALIBRATION.

### CAUTION:

Do not calibrate the meter in the air with unknown CO<sub>2</sub> concentration. It could be calibrated as 400ppm by default which leads to inaccurate measurements.

Wait 10 minutes until the blinking stops and the calibration is completed. To cancel the calibration, turn off the meter at any time.

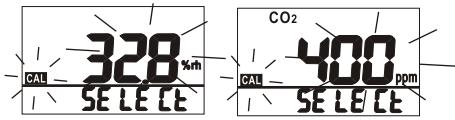


Fig.33

Fig.34

### RH CALIBRATION

To begin, enter calibration mode. Press or to select parameters for calibration and press enter.

The meters default for calibration of humidity is 33% and 75% salt solution. The ambient condition is recommended at 70 ~ 75°F (25°C) and stable humidity. To cancel calibration, turn off the meter.

#### CAUTION:

Do not calibrate the humidity without default calibration salts. Contact UEi for calibration salt or for service

#### 33% Calibration

Plug the sensor probe into 33% salt bottle. Hold down to enter 33% calibration. "CAL" and calibrating value (32.8% if at 77°F) are blinking on the LCD.

#### 75% Calibration

Plug sensor probe into 75% salt bottle and enter calibration mode. In calibration mode, press to select 75% calibration (Fig. 35), press to start. "CAL" calibrating value (75.3% if at 77°F) will blink on the LCD.

Meter will begin calibration and finish in 60 minutes when "CAL" and humidity stop blinking. To cancel the calibration, turn off the meter at any time.



## CO CALIBRATION

When the accuracy becomes a concern, return to UEi for standard calibration. It is necessary to have standard CO gas for calibration.

### CAUTION:

Do not calibrate the meter in the air with unknown CO concentration. It could be calibrated as 400ppm by default which leads to inaccurate measurements.

## TROUBLESHOOTING

### Will Not Power On

- Press  for more than 3 seconds.
- Check that the adaptor is connected and on.
- Check that battery level is sufficient and properly installed.

### Readings Not Changing

- Check whether data hold function is activated (**HOLD** icon is at the left top).

### Slow Response

- Check the air flow channels on the rear. Verify no blockage exists.

### Error Messages

E01/E33: CO<sub>2</sub> sensor is out of order. Try new battery first.  
E02: The value is under range.  
E03: The value is over range  
E04: The original data error results in this error (DP, WB)

### Error Messages Cont.


- E11: Retry humidity calibration
- E16: Retry CO calibration
- E31: Temperature sensor AD damaged
- E32: Memory IC damaged.
- E33: Humidity sensor or circuit damaged.

### PC CONNECTION


The UEi AQM4 can be connected to a PC to download recorded data.

Plug the USB cable into the socket at the right side of the meter and the other port to your PC. Next, install the software on your PC following these procedures.

1. Insert the CD ROM and run installation. Select a preferred directory and click "Next" step by step to finish.

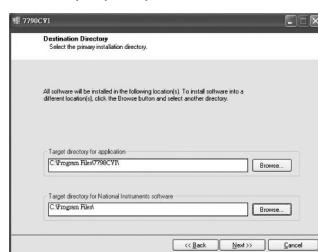


2. After the software installation is completed, it will run USB driver installation next.

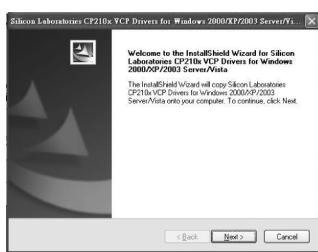


### AUTO CONNECT

Start the software and it will detect the logger connection automatically, indicating the COM port information at the bottom of the main screen as well as the COM Port setting column.

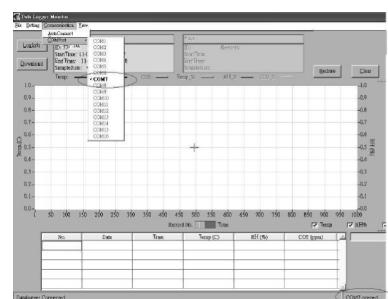

### LOGGER SETTINGS

To set up logging plan, click "Setting" icon and select "Logger". The setting page is opened.

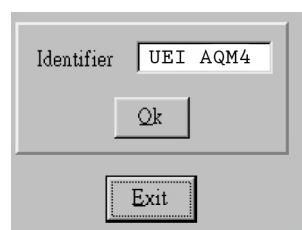


Users can set up the logger identifier number. Click OK for setting and exit the screen to confirm the settings.

## DATA TRANSMISSION

To transmit auto recorded data from the meter, click "Download" icon on the left top side of the main screen. All auto-recorded data in the logger will be transmitted. The raw data with time stamp will display at the lower part of the screen and the graph in the middle.

In the Graph display, the Y-axis indicates Temperature, RH, DP, WBT, CO2, and CO levels in different line colors. The X-axis can be switched to show Time or Recorded Number Stamp.

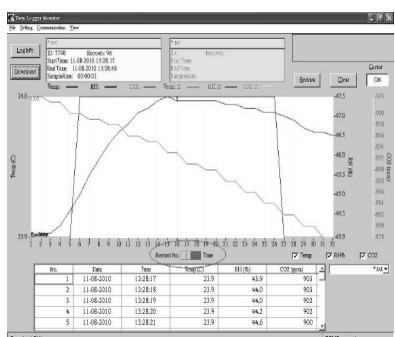

## VIEW MENU

The following functions help to view the GRAPH data in more detailed way.

In the view menu, there are 4 tools to enlarge the Graph data for detailed data review.

**Zoom in:** Hold down "Ctrl" key on the PC keyboard and left click any target point on the graph to zoom in. Right click at any point to zoom out.

**Zoom Window:** Hold down "Ctrl" key and drag click the left button of the mouse to select an area on the Graph and the selected area will be enlarged.

**Zoom X-Axis:** Hold down "Ctrl" key and drag click the left button of the mouse to select an area on the Graph and the X-axis of the selected area will be enlarged.


**Zoom Y-Axis:** Hold down "Ctrl" key and drag click the left button of the mouse to select an area on the Graph and the Y-axis of the selected area will be enlarged.

Three icons on the right top side of the main screen:

**Redraw Button:** After any review and zooming on the Graph, click "Redraw" to reset it to original format.

**Clear Button:** Click "Clear" to delete all data and Graph on the window. A warning box shows up for confirmation. Press "Yes" and all data will be cleared from the PC.

**Cursor Button:** Switch cursor ON and it shows the raw data with the cursor. Click anywhere on the graph and the digital data will be displayed. Switch OFF to disable the function.

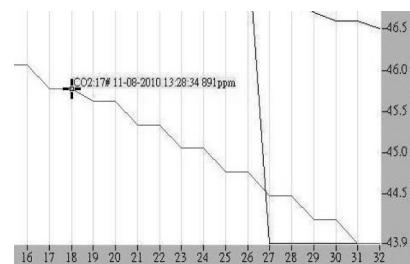

#### DATA PROCESSING

The downloaded data can be **Saved** or **Printed** via "File" processing function.

**Load:** To retrieve saved files, just click "**Load**" and select a desired file and it will be loaded in the main screen with the file details at the left top side.

LogInfo	77597V1.0
	StartTime: 08-11-2011 18:08:11
Download	EndTime: 08-11-2011 18:10:23
	SampleRate: 00:00:06

<b>SPECIFICATION</b>	
<b>Measuring Range</b>	
CO <sub>2</sub>	0 ~ 9999ppm
CO	0 ~ 1000ppm
Temperature	-20 ~ 60°C -5 ~ 140°F
Relative Humidity	0.1% ~ 99.9%
Dew Point Temp.	-20.0 ~ 59.9°C
Wet Bulb Temp	-5.0 ~ 59.9°C
Resolution	1ppm, 0.1°C/F, 0.1%RH
<b>Accuracy</b>	
CO <sub>2</sub>	±30ppm ± 5% of reading (0 ~ 5000ppm)
CO	±10ppm for less than 100ppm ±10% of reading for 101~500ppm ±20% of reading for 501ppm and above
Temperature	±0.6°C/+0.9°F
Relative Humidity	±3% (at 25°C, 10~90%) ±5% (at 25°C, other range)
<b>Response Time</b>	
CO <sub>2</sub>	<30 seconds (90% step change)
CO	<60 seconds (90% step change)
Tair	<2 mins (90% step change)
Relative Humidity	<10 mins (90% step change)
LCD/Meter Size (mm)	26(H) x 44 (L), 205(L) x 70 (W) x 56(H)
Operating Condition	-20 to 50°C (CO <sub>2</sub> Sensor) 0 to 500°C (CO Sensor) -20 to 60°C
Storage Condition	-20 ~ 60°C, 10 ~ 90% RH
Power Supply	AA x 4pcs or 9V Adaptor
Battery Life	>24 hours (Alkaline Battery)
Weight	200g

## CO<sub>2</sub> LEVELS AND GUIDELINES

### REGULATORY EXPOSURE LIMIT

**ASHRAE Standard 62.1-2004:**  
CO<sub>2</sub> concentration in occupied building  
should not exceed 1000ppm.

**Building Bulletin 101 (BB101):** 1500ppm  
UK standards for schools state that CO<sub>2</sub>  
averaged over the whole day (i.e. 9am to  
3:30pm) should not exceed 1500ppm.

**OSHA:** 5000ppm  
Time weighted average over five 8-hour  
work days should not exceed 5000ppm.

**Mak: Germany, Japan, Australia, UK:**  
5000ppm  
Eight hours weighted average in  
occupational exposure limit is 5000ppm.  
(See Ashrae 62.1-2004 Table B-1)

### NON-ENFORCED REFERENCE LEVELS

**NIOSH Recommends**  
**250-350ppm:** normal outdoor ambient  
concentrations

**600ppm:** minimal air quality complaints

**600 - 1000ppm:** less clearly interpreted

**1000ppm:** indicates inadequate ventilation;  
complaints such as headaches, fatigue, eye/  
throat irritation will be more widespread.  
1000ppm should be used as an maximum  
limit for indoor levels.

### CO LEVELS

ppm Symptoms and Applicable Standards

0-1	Normal background levels
9	Maximum indoor air quality level: Maximum allowable concentration per ASHRAE Residential Standards 62-1989 for living area.
25	Maximum limit 8 hours of continuous exposure per California OSHA workplace standards
35	Maximum 8 hours average exposure level per US OSHA workplace standards
50	Maximum concentration for continuous exposure for any 8 hours average level per OSHA standards
100	Evacuate employees from continuous exposure in any 8 hour average level per OSHA standards.
200	Mild headache, fatigue, nausea, and dizziness within 2-3 hours
400	Frontal headache, life threatening after 3 hours. Maximum concentration in flue gas per the US EPA and AGA standards
800	Dizziness, nausea, convulsions, death within 2-3 hours
1600	Nausea within 20 minutes, death within 2-3 hours.