# Temperature





# TD/TF/TG Series

Duct Mounted Temperature Sensors

### **Product Overview**

TD, TF, and TG temperature sensors monitor the temperature of the air inside a duct. The probe is available in multiple lengths to suit multiple applications. All models have standard resistive outputs compatible with building control systems, and all models are warranted for a period of five years.

### Product Identification

	Enclosure	Probe Length	Sensor Type	Output	Cal Certificate
T	Р	口	口	RØ	口
	D = Duct	B = 4'' (102  mm)	B = 100R platinum, RTD	= Resistive	0 = None
	F = Duct w/	C = 6'' (152  mm)	C = 1k platinum, RTD		1 = 1 point Cal validation
	mounting box	D = 8'' (203  mm)	D = 10k T2, Thermistor		2 = 2 point Cal validation
	G = Duct w/ water	E = 12'' (305  mm)	E = 2.2k, Thermistor		
	resistant housing	g $F = 18'' (457 \text{ mm})$	F = 3k, Thermistor		
		G = 24'' 610  mm	G = 10k CPC, Thermistor		
		K = 36'' (914  mm)	H = 10k T3, Thermistor		
			I = 1k Balco (Nickel-iron) RTD		
			J = 10k Dale, Thermistor		
			K = 10k  w/11k  shunt, Thermis	stor	
			M = 20k NTC, Thermistor		
			N = 1800 ohm, Thermistor		
			R = 10k US, Thermistor		
			S = 10k 3A221, Thermistor		
			T = 100k, Thermistor		

# Specifications

<u></u>			
Wiring	Wiring 22 AWG; 2-wire RTD/Thermistor		
Housing	Stainless Steel		
COMPLIANCE INFORMATION			
Approvals	CE		

U = 20k "D", Thermistor

Z = 10k E1, Thermistor CC = 15k, Thermistor

W = 10k T2 high accuracy, Thermistor Y = 10k T3 high accuracy, Thermistor

#### NOTICE


- This product is not intended for life or safety applications. Do not install this product in hazardous or classified locations. Read and understand the instructions before installing
- this product.

  Turn off all power supplying equipment before working on it. The installer is responsible for conformance to all applicable codes.

No responsibility is assumed by Veris Industries for any consequences arising out of the



#### Dimensions

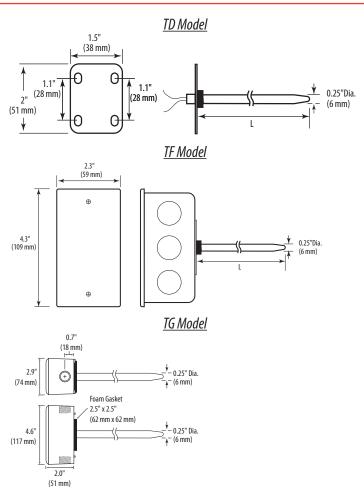

## Installation

- 1. Drill a 3/8" diameter hole into a duct for the sensor probe.
- 2. Insert the probe into the duct.
- 3. Secure the junction box housing (TF/TG) or the mounting flange (TD) to the outer surface of the duct using the self-tapping screws provided.
- 4. Wire as shown.

